

**MODEL 123A
LEGACY® SERIES AIR CONDITIONER
WITH PURON® REFRIGERANT
SIZES 018 TO 060
1-1/2 TO 5 NOMINAL TONS**



Product Data



**LEGACY™
LINE**

Bryant's Air Conditioners with Puron® refrigerant provide a collection of features unmatched by any other family of equipment. Air Conditioner model 123A has been designed utilizing Bryant's Puron refrigerant. The environmentally sound refrigerant allows you to make a responsible decision in the protection of the earth's ozone layer.

As an Energy Star® Partner, Bryant Heating & Cooling has determined that this product meets the Energy Star® guidelines for energy efficiency. Refer to the combination ratings in the Product Data for system combinations that meet Energy Star® guidelines.

INDUSTRY LEADING FEATURES / BENEFITS

Efficiency

- 13 SEER/11 EER
- Microtube Technology™ refrigeration system
- Indoor air quality accessories available

Sound

- Sound level as low as 74 dBA
- Compressor sound blanket

Comfort

- System supports Thermidistat™ or standard thermostat controls

Diagnostics

- TechAssist™ with 6-step diagnostics at-a-glance

Reliability

- Puron® refrigerant - environmentally sound, won't deplete the ozone layer and low lifetime service cost.
- Front-seating service valves
- Scroll compressor
- Internal pressure relief valve
- Internal thermal overload
- Low pressure switch
- High pressure switch
- Filter drier
- Balanced refrigeration system for maximum reliability

Durability

DuraGuard™ protection package:

- Solid, Durable sheet metal construction
- Steel louver coil guard
- Baked-on, complete coverage, powder paint
- Color matched cabinet screws

Applications

- Long-line - up to 250 feet total equivalent length, up to 200 feet condenser above evaporator, or up to 80 ft. evaporator above condenser (See Longline Guide for more information.)
- Low ambient (down to -20°F) with accessory kit

Warranty

Single Phase

- 10 year limited compressor warranty
- 5 year limited parts warranty

3-Phase

- 5 year limited compressor warranty
- 1 year limited parts warranty

MODEL NUMBER NOMENCLATURE

1	2	3	4	5	6	7	8	9	10	11	12	14
N	N	N	A	A/N	N	N	N	N	A/N	A/N	N	A
1	2	3	A	N	A	0	3	6	0	0	0	a
Product Family	Tier	SEER	Major Series	Voltage	Variations	Cooling Capacity			Open	Open	Open	Minor Series
1=AC	2= Legacy	4=14 SEER	A=Puron	N= 208-230-1 208/230-3 460-3	A = Standard				0=Not Defined	0= Not Defined	0= Not Defined	A = Original Series



As an Energy Star® Partner, Bryant Heating & Cooling has determined that this product meets the ENERGY STAR® guidelines for energy efficiency.

Refer to the combination ratings in Product Data for system combinations that meet Energy Star guidelines.

STANDARD FEATURES

Feature	18	24	30	36	42	48	60
Puron Refrigerant	X	X	X	X	X	X	X
13 SEER	X	X	X	X	X	X	X
Scroll Compressor	X	X	X	X	X	X	X
Louvered Coil Guard	X	X	X	X	X	X	X
Field Installed Filter Drier	X	X	X	X	X	X	X
Front Seating Service Valves	X	X	X	X	X	X	X
Internal Pressure Relief Valve	X	X	X	X	X	X	X
Internal Thermal Overload	X	X	X	X	X	X	X
Long Line capability	X	X	X	X	X	X	X
Low Ambient capability with Kit	X	X	X	X	X	X	X
Low Pressure (loss of charge) Switch	X	X	X	X	X	X	X
High Pressure Switch	X	X	X	X	X	X	X
Compressor Sound Blanket	X	X	X	X	X	X	X
TechAssist™ Diagnostics-at-a-glance	X	X	X	X	X	X	X

PHYSICAL DATA

UNIT SIZE SERIES	018-A	024-A	030-A	036-A	042-A	048-A	060-A
Operating Weight (lb)	130	130	142	161	205	228	251
Shipping Weight (lb)	151	151	164	184	233	256	285
Compressor Type	Scroll						
REFRIGERANT	Puron® (R-410A) Refrigerant						
Control	TXV (Puron® Hard Shutoff)						
Charge (lb)	4.25	4.35	4.75	5.25	6.2	8.35	8.75
COND FAN	Propeller Type, Direct Drive						
Air Discharge	Vertical						
Air Qty (CFM)	1880	2200	2200	2950	3170	3365	4050
Motor HP	1/12	1/10	1/10	1/4	1/5	1/4	1/5
Motor RPM	1100	1100	1100	1100	1100	1100	825
COND COIL							
Face Area (Sq ft)	9.85	9.85	11.49	14.77	17.25	21.56	25.15
Fins per In.	20	20	25	25	25	25	25
Rows	1	1	1	1	1	1	1
Circuits	3	3	3	3	4	5	5
VALVE CONNECT. (In. ID)							
Vapor	5/8	5/8	3/4	3/4	7/8	7/8	7/8
Liquid	3/8						
REFRIGERANT TUBES* (In. OD)							
Vapor (0-80 Ft Tube Length)	5/8	5/8	3/4	3/4	7/8	7/8	1-1/8
Liquid (0-80 Ft Tube Length)	3/8						

* For tubing sets between 80 and 200 ft. horizontal or 20 ft. vertical differential, consult the Longline Guideline.
 Note: See unit Installation Instruction for proper installation.

VAPOR LINE SIZING AND COOLING CAPACITY LOSS PURON REFRIGERANT 1-STAGE AIR CONDITIONER APPLICATIONS

LONG LINE APPLICATION: An application is considered "Long line" when the total equivalent tubing length exceeds 80 ft or when there is more than 20 Ft vertical separation between indoor and outdoor units. These applications require additional accessories and system modifications for reliable system operation. The maximum allowable total equivalent length is 250Ft. The maximum vertical separation is 200 Ft when outdoor

unit is above indoor unit, and 80 Ft when the outdoor unit is below the indoor unit. Refer to Accessory Usage Guideline below for required accessories. See Long-Line Application Guideline for required piping and system modifications. Also, refer to the table below for the acceptable vapor tube diameters based on the total length to minimize the cooling capacity loss.

Unit Nominal Size (Btuh)	Acceptable Liquid Line Diameters (In. OD)	Acceptable Vapor Line Diameters (In. OD)	Cooling Capacity Loss (%)										
			Standard Application			Long Line Application Requires Accessories							
			25	50	80	80+	100	125	150	175	200	225	250
18000 1 Stage Puron AC	3/8	1/2	1	2	3	3	4	6	7	8	9	10	12
		5/8	0	0	1	1	1	1	2	2	3	3	3
24000 1 Stage Puron AC	3/8	5/8	0	1	1	1	2	3	3	4	4	5	6
		3/4	0	0	0	0	0	1	1	1	1	1	2
		7/8	0	0	0	0	0	0	0	0	0	0	1
30000 1 Stage Puron AC	3/8	5/8	1	2	3	3	3	4	5	6	7	8	9
		3/4	0	0	1	1	1	1	2	2	2	3	3
		7/8	0	0	0	0	0	1	1	1	1	1	1
36000 1 Stage Puron AC	3/8	5/8	1	2	4	4	5	6	7	9	10	11	13
		3/4	0	0	1	1	1	2	2	3	3	4	4
		7/8	0	0	0	0	0	1	1	1	1	2	2
42000 1 Stage Puron AC	3/8	3/4	0	1	2	2	2	3	4	4	5	6	6
		7/8	0	0	1	1	1	1	2	2	2	3	3
		1 1/8	0	0	0	0	0	0	0	0	0	0	1
48000 1 Stage Puron AC	3/8	3/4	0	1	2	2	3	4	5	5	6	7	8
		7/8	0	0	1	1	1	2	2	2	3	3	4
		1 1/8	0	0	0	0	0	0	0	0	1	1	1
60000 1 Stage Puron AC	3/8	3/4	1	2	4	4	5	6	7	9	10	11	12
		7/8	0	1	2	2	2	3	4	4	5	5	6
		1 1/8	0	0	0	0	1	1	1	1	1	1	2

Standard Length = 80 Ft or less total equivalent length

Applications in this area are long line. Accessories are required as shown recommended on Long Line Application Guidelines

Applications in this area may have height restrictions that limit allowable total equivalent length, when outdoor unit is below indoor unit See Long Line Application Guidelines

123A

ACCESSORIES

ORDER NUMBER	DESCRIPTION	018-A	024-A	030-A	036-A	042-A	048-A	060-A
KAACH1201AAA	CRANKCASE HTR					X	X	X
KAACH1401AAA	CRANKCASE HTR	X	X	X	X			
KSACY0101AAA	CYCLE PROTECTOR	X	X	X	X	X	X	X
KAAFT0101AAA	FREEZE THERMOSTAT	X	X	X	X	X	X	X
KSAHS1701AAA	HARD START (CAP / RELAY)	X	X	X	X	X	X	X
KSALA0301410	LOW AMBIENT PSW	X	X	X	X	X	X	X
HC32GE234	MOTOR FAN BALL BEARING 230V	X						
HC34GE239	MOTOR FAN BALL BEARING 230V		X	X				
HC38GE228	MOTOR FAN BALL BEARING 230V					X		
HC40GE226	MOTOR FAN BALL BEARING 230V				X			
HC40GE228	MOTOR FAN BALL BEARING 230V						X	X
KSALA0601AAA	MOTORMASTER 230V	X	X	X	X	X	X	X
KAALS0201LLS	SOLENOID VALVE	X	X	X	X	X	X	X
KAACS0201PTC	START ASSIST PTC	X	X	X	X	X	X	X
KSASF0101AAA	SUPPORT FEET	X	X	X	X	X	X	X
KAATD0101TDR	TIME DELAY RELAY	X	X	X	X	X	X	X
KSATX0201PUR	TXV PURON HSO	X	X	X				
KSATX0301PUR	TXV PURON HSO				X	X		
KSATX0401PUR	TXV PURON HSO						X	
KSATX0501PUR	TXV PURON HSO							X
KAAWS0101AAA	WINTER START	X	X	X	X	X	X	X

x = Accessory

THERMOSTAT / SUBBASE PKG.	DESCRIPTION
TSTATBBPRH01-B	Thermostat Control – Programmable / Non-Programmable Thermostat with Humidity control
TSTATBBPAC01-B	Thermostat – Auto Changeover, 7-Day Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool
TSTATBBNAC01-C	Thermostat – Auto Changeover, Non-Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool
TSTATBBBAC01-B	Builder's Thermostat – Manual Changeover, Non-Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool
TSTATBBSEN01-B	Outdoor Air Temperature Sensor
TSTATXXBBP01	Backplate for Builder's Thermostat
TSTATXXNBP01	Backplate for Non-Programmable Thermostat
TSTATXXPPB01	Backplate for Programmable Thermostat
TSTATXXCNV10	Thermostat Conversion Kit (4 to 5 wires) – 10 Pack

ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW-AMBIENT COOLING APPLICATIONS (Below 55° F)	REQUIRED FOR LONG LINE APPLICATIONS* (Over 80 Ft.)	REQUIRED FOR SEA COAST APPLICATIONS (Within 2 miles)
Crankcase Heater	Yes	Yes	No
Evaporator Freeze Thermostat	Yes	No	No
Accumulator	No	No	No
Compressor Start Assist Capacitor and Relay	Yes	Yes	No
Motor Master® Control or Low-ambient Pressure Switch	Yes	No	No
Support Feet	Recommended	No	Recommended
Liquid Line Solenoid Valve	No	See Long-Line Application Guideline	No
Ball Bearing Fan Motor	Yes†	No	No

* For tubing line sets between 80 and 200 ft. and/or 20 ft. vertical differential, refer to Residential Split-System Longline Application Guideline.

† Required for Low-Ambient Controller (full modulation feature) and MotorMaster® Control only.

Accessory Description and Usage (Listed Alphabetically)

1. Ball-Bearing Fan Motor

A fan motor with ball bearings which permits speed reduction while maintaining bearing lubrication.

Usage Guideline:

Required on all units when MotorMaster® —

2. Compressor Start Assist - Capacitor and Relay

Start capacitor and relay gives a "hard" boost to compressor motor at each start up.

Usage Guideline:

Required for reciprocating compressors in the following applications:

- Long line
- Low ambient cooling
- Hard shut off expansion valve on indoor coil
- Liquid line solenoid on indoor coil

Required for single-phase scroll compressors in the following applications:

- Long line
- Low ambient cooling

Suggested for all compressors in areas with a history of low voltage problems.

3. Compressor Start Assist — PTC Type

Solid state electrical device which gives a "soft" boost to the compressor at each start-up.

Usage Guideline:

Suggested in installations with marginal power supply.

4. Crankcase Heater

An electric resistance heater which mounts to the base of the compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Usage Guideline:

- Required in low ambient cooling applications.
- Required in long line applications.
- Suggested in all commercial applications.

5. Cycle Protector

The cycle protector is designed to prevent compressor short cycling. This control provides an approximate 5-minute delay after power to the compressor has been interrupted for any reason, including power outage, protector control trip, thermostat jiggling, or normal cycling.

6. Evaporator Freeze Thermostat

An SPST temperature-actuated switch that stops unit operation when evaporator reaches freeze-up conditions.

Usage Guideline:

Required when low ambient kit has been added.

7. Low-Ambient Pressure Switch Kit

A long life pressure switch which is mounted to outdoor unit service valve. It is designed to cycle the outdoor fan motor in order to maintain head pressure within normal operating limits (approximately 100 psig to 225 psig). The control will maintain working head pressure at low-ambient temperatures down to 0°F when properly installed.

Usage Guideline:

A Low-Ambient Pressure Switch or MotorMaster® Low-Ambient Controller must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

8. MotorMaster® Low-Ambient Controller

A fan-speed control device activated by a temperature sensor, designed to control condenser fan motor speed in response to the saturated, condensing temperature during operation in cooling mode only. For outdoor temperatures down to -20°F (-28.9°C), it maintains condensing temperature at 100°F ±10°F (37.8°C ± -12°C).

Usage Guideline:

A MotorMaster® Low Ambient Controller or Low-Ambient Pressure Switch must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

Suggested for all commercial applications.

9. Outdoor Air Temperature Sensor

Designed for use with Bryant Thermostats listed in this publication. This device enables the thermostat to display the outdoor temperature. This device also

is required to enable special thermostat features such as auxiliary heat lock out.

Usage Guideline:

Suggested for all Bryant thermostats listed in this publication.

Accessory Description and Usage (Listed Alphabetically) (Continued)

10. Sound Hood

Wraparound sound reducing cover for the compressor. Reduces the sound level by up to 2 dBA.

Usage Guideline:

Suggested when unit is installed closer than 15 ft to quiet areas, bedrooms, etc.

Suggested when unit is installed between two houses less than 10 ft apart.

11. Support Feet

Four stick-on plastic feet that raise the unit 4 in. above the mounting pad. This allows sand, dirt, and other debris to be flushed from the unit base, minimizing corrosion.

Usage Guideline:

Suggested in the following applications:

Coastal installations.

Windy areas or where debris is normally circulating.

Rooftop installations.

For improved sound ratings.

12. Thermostatic Expansion Valve (TXV)

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator.

Kit includes valve, adapter tubes, and external equalizer tube. Hard shut off types are available.

NOTE: When using a hard shut off TXV with single phase reciprocating compressors, a Compressor Start Assist Capacitor and Relay is required.

Usage Guideline:

Required to achieve ARI ratings in certain equipment combinations. Refer to combination ratings.

Hard shut off TXV or LLS required in air conditioner long line applications.

Required for use on all zoning systems.

13. Time-Delay Relay

An SPST delay relay which briefly continues operation of indoor blower motor to provide additional cooling after the compressor cycles off.

NOTE: Most indoor unit controls include this feature. For those that do not, use the guideline below.

Usage Guideline:

For improved efficiency ratings for certain combinations of indoor and outdoor units. Refer to ARI Unitary Directory.

14. Winter Start Control

This control is designed to alleviate nuisance opening of the low-pressure switch by bypassing it for the first 3 minutes of operation.

ELECTRICAL DATA

UNIT SIZE	V/PH	OPER VOLTS*		COMPR		FAN	MCA	MIN WIRE SIZE [†]	MIN WIRE SIZE [†]	MAX LENGTH (FT) [‡]	MAX LENGTH (FT) [‡]	MAX FUSE** or CKT BRK AMPS
		MAX	MIN	LRA	RLA	FLA		60° C	75° C	60° C	75° C	
018-A	208-230-1	253	197	48.0	9.0	0.5	11.7	14	14	67	64	15
024-A				58.3	13.5	0.75	17.6	14	14	45	43	25
030-A				64.0	12.8	0.75	16.8	14	14	47	45	25
036-A				77.0	14.1	1.4	19.0	12	12	66	63	30
042-A				112.0	17.9	1.1	23.5	12	12	53	51	40
048-A				109.0	19.9	1.4	26.2	10	10	76	73	40
060-A				134.0	26.4	1.2	34.2	8	8	91	86	50
030-A	208/230-3	253	197	58.0	10.1	0.8	13.4	14	14	68	65	20
036-A				71.0	9.2	1.4	12.9	14	14	70	67	20
042-A				88.0	13.5	1.2	18.1	12	12	80	76	30
048-A				83.1	13.6	1.2	18.2	12	12	79	76	30
060-A				110.0	17.7	1.2	23.3	12	12	62	59	40
036-A	460-3	506	414	38.0	5.6	0.7	7.8	14	14	233	222	15
042-A				44.0	6.0	0.5	8.0	14	14	227	216	15
048-A				41.0	6.1	0.6	8.2	14	14	222	211	15
060-A				52.0	7.8	0.6	10.3	14	14	177	168	15

* Permissible limits of the voltage range at which the unit will operate satisfactorily

† If wire is applied at ambient greater than 30° C (86° F), consult table 310-16 of the NEC (ANSI/NFPA 70). The ampacity of non-metallic-sheathed cable (NM), trade name ROMEX, shall be that of 60° C (140° F) conditions, per the NEC (ANSI/NFPA 70) Article 336-26. If other than uncoated (no-plated), 60 or 75° C (140 or 167° C) insulation, copper wire (solid wire for 10 AWG or smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the NEC (ANSI/NFPA 70).

‡ Length shown is as measured 1 way along wire path between unit and service panel for voltage drop not to exceed 2%.

** Time-Delay fuse.

FLA - Full Load Amps

LRA - Locked Rotor Amps

MCA - Minimum Circuit Amps

RLA - Rated Load Amps

NOTE: Control circuit is 24-V on all units and requires external power source. Copper wire must be used from service disconnect to unit.

All motors/compressors contain internal overload protection.

123A

A-WEIGHTED SOUND LEVEL (DBA)

UNIT SIZE	STANDARD RATING	TYPICAL OCTAVE BAND SPECTRUM (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
018-A	74	50.0	61.5	64.5	66.5	64.0	61.0	54.5
024-A	74	55.5	63.5	67.0	70.0	66.0	63.5	57.0
030-A	74	52.5	63.0	68.5	70.0	66.5	62.5	56.5
036-A	74	57.0	65.0	67.5	69.5	67.5	65.0	60.0
042-A	74	55.0	64.0	68.0	68.5	64.5	60.0	54.0
048-A	74	52.5	62.5	65.5	69.0	63.5	60.5	56.0
060-A	74	54.0	59.0	65.5	67.5	63.5	60.0	55.5

CHARGING SUBCOOLING (TXV-TYPE EXPANSION DEVICE)

UNIT SIZE-SERIES	REQUIRED SUBCOOLING (°F)
018-A	8
024-A	13
030-A	16
036-A	16
042-A	10
048-A	17
060-A	11

DIMENSIONS



UNIT	SERIES	ELECTRICAL CHARACTERISTICS				A	B	C	D	E	F	G	H	J	K	L	M	N	P	OPERATING WEIGHT	SHIPPING WEIGHT	SHIPPING DIMENSIONS (L x W x H)		
		X	0	X	0																	25 3/4"	25"	3 3/4"
123A018	A	X	0	0	0	25 3/4"	25"	3 3/4"	5/8"	4 7/16"	21 1/4"	9 1/8"	5/16"	3"	2 13/16"	1/2"	12 1/2"	12 3/8"	12 3/8"	130#	151#	26 7/8"	26 7/8"	29 1/4"
123A024	A	X	0	0	0	25 3/4"	25"	3 3/4"	5/8"	4 7/16"	21 1/4"	9 1/8"	5/16"	3"	2 13/16"	1/2"	13"	11 7/8"	12 3/8"	130#	151#	26 7/8"	26 7/8"	29 1/4"
123A030	A	X	0	0	X	25 3/4"	28 7/16"	3 3/4"	3/4"	4 7/16"	21 1/4"	9 1/8"	5/16"	3"	2 13/16"	1/2"	12 1/4"	13 3/4"	12 3/4"	142#	164#	26 7/8"	26 7/8"	32 5/8"
123A036	A	X	0	X	X	25 3/4"	35 1/4"	3 3/4"	3/4"	4 7/16"	21 1/4"	9 1/8"	5/16"	3"	2 13/16"	1/2"	12"	13"	14 3/4"	184#	161#	26 7/8"	26 7/8"	39 7/16"
123A042	A	X	0	X	X	31 3/16"	32 5/16"	3 7/8"	7/8"	6 9/16"	24 11/16"	9 1/8"	5/16"	3"	2 15/16"	5/8"	15 3/4"	16 1/4"	13 3/4"	205#	233#	32 5/16"	32 5/16"	36 1/16"
123A048	A	X	0	X	X	31 3/16"	39 1/8"	3 7/8"	7/8"	6 9/16"	24 11/16"	9 1/8"	5/16"	3"	2 15/16"	5/8"	14 1/4"	17 1/4"	19 1/4"	228#	256#	32 5/16"	32 5/16"	42 7/8"
123A060	A	X	0	X	X	35"	39 1/8"	3 7/8"	7/8"	6 9/16"	28 7/16"	9 1/8"	5/16"	3"	2 15/16"	5/8"	20 5/8"	19 3/4"	18 3/8"	251#	285#	36 1/8"	36 1/8"	42 7/8"

X = YES
0 = NO

208-230-160	230-160	208/230-3-60	460-3-60
-------------	---------	--------------	----------

NOTES:

1. ALLOW 30" CLEARANCE TO SERVICE SIDE OF UNIT, 48" ABOVE UNIT, 6" ON ONE SIDE, 12" ON REMAINING SIDE, AND 24" BETWEEN UNITS FOR PROPER AIRFLOW.
2. MINIMUM OUTDOOR OPERATING AMBIENT IN COOLING MODE IS 55°F, MAX. 125°F.
3. SERIES DESIGNATION IS THE 14TH POSITION OF THE UNIT MODEL NUMBER.
4. CENTER OF GRAVITY

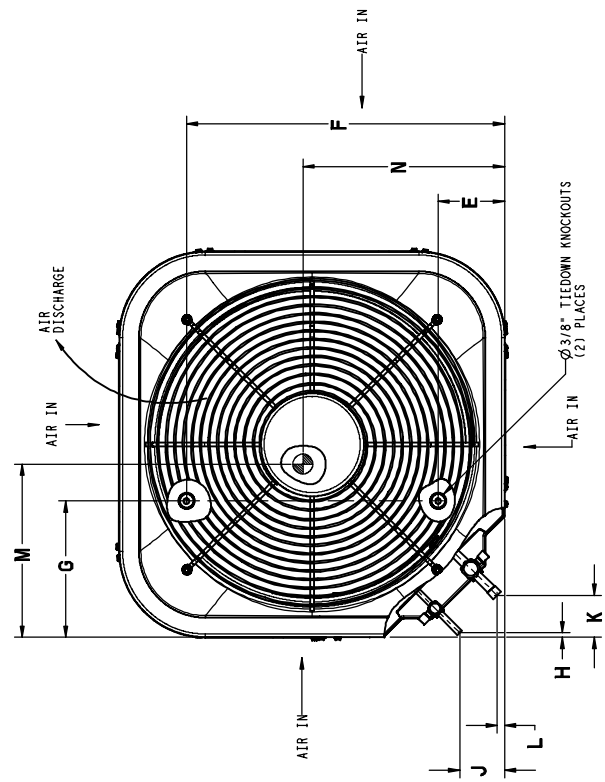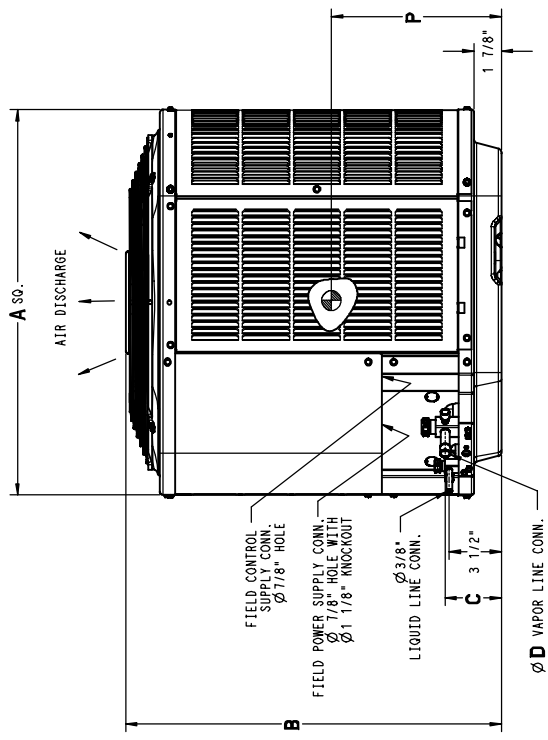

UNIT SIZE	MINIMUM MOUNTING PAD DIMENSIONS
18, 24, 30, 36	26" X 26"
42, 48	31 1/2" X 31 1/2"
60	35" X 35"

COMBINATION RATINGS

Unit Size – Series	Indoor Model	Total Cap. BTUH	Factory Supplied Enhancement	SEER		EER	Furnace Model
				Standard Rating	TDR†		
018–A	*CAP**1814A**	17,500	TXV		13.00	11.00	
	CAP**1814A**	17,200	TDR&TXV	14.50		11.70	315(A,J)AV036070
	CAP**2414A**	17,700	TXV		13.00	11.00	
	CAP**2414A**	17,500	TDR&TXV	14.50		11.70	315(A,J)AV036070
	CAP**2417A**	17,700	TXV		13.00	11.00	
	CAP**2417A**	17,500	TDR&TXV	14.50		11.70	355AAV042060
	CAP**2417A**	17,600	TDR&TXV	14.50		11.70	315(A,J)AV048090
	CNPV*1814A**	17,400	TXV		13.00	11.00	
	CNPV*1814A**	17,200	TDR&TXV	14.50		11.70	315(A,J)AV036070
	CNPV*2414A**	17,500	TXV		13.00	11.00	
	CNPV*2414A**	17,300	TDR&TXV	14.50		11.70	315(A,J)AV036070
	CNPV*2414A**	17,300	TDR&TXV	14.50		11.70	315(A,J)AV048090
	CNPV*2417A**	17,500	TXV		13.00	11.00	
	CNPV*2417A**	17,300	TDR&TXV	14.50		11.70	355AAV042060
	CNPV*2417A**	17,400	TDR&TXV	14.50		11.70	315(A,J)AV048090
	CNPH*2417A**	17,500	TXV		13.00	11.00	
	CNPH*2417A**	17,300	TDR&TXV	14.50		11.70	355AAV042040
	CNPH*2417A**	17,300	TDR&TXV	14.50		11.70	355AAV042060
	CNPH*2417A**	17,400	TDR&TXV	14.50		11.70	355AAV042080
	CNPH*2417A**	17,300	TDR&TXV	14.50		11.70	315(A,J)AV036070
	CNPH*2417A**	17,400	TDR&TXV	14.50		11.70	315(A,J)AV048090
	CNPF*2418A**	17,500	TXV		13.00	11.00	
	CSPH*2412A**	17,000	TXV		13.00	11.00	
	CSPH*2412A**	16,700	TDR&TXV	14.50		11.70	355AAV042040
CSPH*2412A**	16,700	TDR&TXV	14.50		11.70	355AAV042060	
CSPH*2412A**	16,700	TDR&TXV	14.50		11.70	355AAV042080	
CSPH*2412A**	16,600	TDR&TXV	14.50		11.70	315(A,J)AV036070	
CSPH*2412A**	16,700	TDR&TXV	14.50		11.70	315(A,J)AV048090	
FY4ANF018	17,400	TDR&TXV	13.00		11.00		
FY4ANF024	17,500	TDR&TXV	13.00		11.00		
FX4CNF018	17,600	TDR&TXV	14.50		11.70		
FX4CNF024	17,900	TDR&TXV	14.50		11.70		
FE4ANF002	17,800	TDR&TXV	15.00		12.00		
FF1ENP018	17,400	TDR&TXV	13.00		11.00		
FF1ENP024	17,600	TDR&TXV	13.20		11.00		
FV4BNF002	17,800	TDR&TXV	15.00		12.00		
*CAP**2414A**	23,000	TXV		13.00	11		
CAP**2414A**	22,600	TDR&TXV	14.00		11.50	315(A,J)AV036070	
CAP**2417A**	22,800	TXV		13.00	11.00		
CAP**2417A**	22,600	TDR&TXV	14.00		11.50	355AAV042060	
CAP**2417A**	22,600	TDR&TXV	14.50		11.70	315(A,J)AV048090	
CAP**3014A**	23,000	TXV		13.00	11.00		
CAP**3014A**	22,800	TDR&TXV	14.00		11.50	315(A,J)AV036070	
CAP**3017A**	23,000	TXV		13.00	11.00		
CAP**3017A**	22,800	TDR&TXV	14.50		11.70	355AAV042060	
CAP**3017A**	22,800	TDR&TXV	14.50		11.70	315(A,J)AV048090	
CNPV*2414A**	22,600	TXV		13.00	11.00		
CNPV*2414A**	22,400	TDR&TXV	14.00		11.50	315(A,J)AV036070	
CNPV*2417A**	22,600	TXV		13.00	11.00		
CNPV*2417A**	22,400	TDR&TXV	14.00		11.50	355AAV042060	
CNPV*2417A**	22,400	TDR&TXV	14.00		11.50	315(A,J)AV048090	
CNPV*3014A**	22,800	TXV		13.00	11.00		
CNPV*3014A**	22,600	TDR&TXV	14.00		11.15	315(A,J)AV036070	
CNPV*3017A**	22,800	TXV		13.00	11.00		
CNPV*3017A**	22,600	TDR&TXV	14.50		11.70	355AAV042060	
CNPV*3017A**	22,600	TDR&TXV	14.50		11.70	315(A,J)AV048090	

See notes on pg. 14

123A

COMBINATION RATINGS CONTINUED

123A

Unit Size – Series	Indoor Model	Total Cap. BTUH	Factory Supplied Enhancement	SEER		EER	Furnace Model
				Standard Rating	TDR†		
024–A	CNPH*2417A**	22,600	TXV		13.00	11.00	
	CNPH*2417A**	22,400	TDR&TXV	14.00		11.50	355AAV042040
	CNPH*2417A**	22,400	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CNPH*3017A**	22,800	TXV		13.00	11.00	
	CNPH*3017A**	22,600	TDR&TXV	14.50		11.70	355AAV042040
	CNPH*3017A**	22,600	TDR&TXV	14.50		11.70	315(A,J)AV036070
	CNPF*2418A**	22,600	TXV		13.00	11.00	
	CSPH*2412A**	22,000	TXV		13.00	11.00	
	CSPH*2412A**	21,800	TDR&TXV	14.00		11.50	355AAV042040
	CSPH*2412A**	21,800	TDR&TXV	14.00		11.50	355AAV042060
	CSPH*2412A**	21,800	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CSPH*2412A**	21,800	TDR&TXV	14.50		11.70	315(A,J)AV048090
	CSPH*2412A**	21,800	TDR&TXV	14.00		11.50	315(A,J)AV060110
	CSPH*2412A**	21,800	TDR&TXV	14.00		11.50	315(A,J)AV066135
	CSPH*3012A**	22,000	TXV		13.00	11.00	
	CSPH*3012A**	22,000	TDR&TXV	14.50		11.70	355AAV042040
	CSPH*3012A**	21,800	TDR&TXV	14.50		11.70	355AAV042060
	CSPH*3012A**	22,000	TDR&TXV	14.50		11.70	355AAV042080
	CSPH*3012A**	21,800	TDR&TXV	14.50		11.70	355AAV060080
	CSPH*3012A**	22,000	TDR&TXV	14.50		11.70	355AAV060100
	CSPH*3012A**	21,800	TDR&TXV	14.50		11.70	355AAV060120
	CSPH*3012A**	21,800	TDR&TXV	14.50		11.70	315(A,J)AV036070
	CSPH*3012A**	22,000	TDR&TXV	14.50		11.70	315(A,J)AV048090
	CSPH*3012A**	22,000	TDR&TXV	14.50		11.70	315(A,J)AV060110
	CSPH*3012A**	22,000	TDR&TXV	14.50		11.70	315(A,J)AV066135
	CSPH*3012A**	22,000	TDR&TXV	14.50		11.70	315(A,J)AV066155
	FY4ANF024	22,600	TDR&TXV	13.00		11.00	
	FY4ANF030	22,800	TDR&TXV	13.20		11.00	
	FX4CNF024	23,000	TDR&TXV	14.00		11.50	
	FX4CNF030	23,200	TDR&TXV	14.00		11.50	
	FE4ANF002	23,000	TDR&TXV	14.50		11.70	
	FE4ANF003	23,000	TDR&TXV	14.50		11.70	
	FF1ENP024	22,600	TDR&TXV	13.00		11.00	
	FF1ENP030	22,600	TDR&TXV	13.00		11.00	
	FV4BNF002	23,000	TDR&TXV	14.50		11.70	
	FV4BNF003	23,000	TDR&TXV	15.00		12.00	
	*CAP**3014A**	28,000	TXV		13.00	11	
	CAP**3014A**	27,600	TDR&TXV	13.50		11.20	315(A,J)AV036070
	CAP**3017A**	28,000	TXV		13.00	11.00	
	CAP**3017A**	27,600	TDR&TXV	14.00		11.50	355AAV042060
	CAP**3017A**	27,600	TDR&TXV	14.00		11.50	315(A,J)AV048090
	CAP**3614A**	28,000	TXV		13.00	11.00	
CAP**3614A**	27,600	TDR&TXV	14.00		11.50	315(A,J)AV036070	
CAP**3617A**	28,000	TXV		13.00	11.00		
CAP**3617A**	27,600	TDR&TXV	14.00		11.50	355AAV042060	
CAP**3617A**	27,800	TDR&TXV	14.00		11.50	315(A,J)AV048090	
CAP**3621A**	28,000	TXV		13.00	11.00		

See notes on pg. 14

COMBINATION RATINGS CONTINUED

Unit Size – Series	Indoor Model	Total Cap. BTUH	Factory Supplied Enhancement	SEER		EER	Furnace Model
				Standard Rating	TDR†		
030-A	CAP**3621A**	27,800	TDR&TXV	14.00		11.50	355AAV042080
	CAP**3621A**	27,800	TDR&TXV	14.00		11.50	315(A,J)AV060110
	CNPV*3014A**	27,800	TXV		13.00	11.00	
	CNPV*3014A**	27,400	TDR&TXV	13.50		11.20	315(A,J)AV036070
	CNPV*3017A**	27,800	TXV		13.00	11.00	
	CNPV*3017A**	27,400	TDR&TXV	14.00		11.50	355AAV042060
	CNPV*3017A**	27,400	TDR&TXV	14.00		11.50	315(A,J)AV048090
	CNPV*3617A**	27,800	TXV		13.00	11.00	
	CNPV*3617A**	27,400	TDR&TXV	14.00		11.50	355AAV042060
	CNPV*3617A**	27,400	TDR&TXV	14.00		11.50	315(A,J)AV048090
	CNPV*3621A**	27,800	TXV		13.00	11.00	
	CNPV*3621A**	27,400	TDR&TXV	14.00		11.50	355AAV042080
	CNPV*3621A**	27,600	TDR&TXV	14.00		11.50	315(A,J)AV060110
	CNPH*3017A**	27,800	TXV		13.00	11.00	
	CNPH*3017A**	27,400	TDR&TXV	13.50		11.20	355AAV042040
	CNPH*3017A**	27,400	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CNPH*3617A**	27,800	TXV		13.00	11.00	
	CNPH*3617A**	27,400	TDR&TXV	13.50		11.20	355AAV042040
	CNPH*3617A**	27,400	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CNPF*3618A**	27,800	TXV		13.00	11.00	
	CSPH*3012A**	27,000	TXV		13.00	11.00	
	CSPH*3012A**	26,800	TDR&TXV	13.50		11.20	355AAV042040
	CSPH*3012A**	26,800	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CSPH*3612A**	27,400	TXV		13.20	11.00	
	CSPH*3612A**	27,200	TDR&TXV	14.00		11.50	355AAV042040
	CSPH*3612A**	27,200	TDR&TXV	14.00		11.50	315(A,J)AV036070
	FY4ANF030	27,600	TDR&TXV	13.00		11.00	
	FY4ANF036	27,800	TDR&TXV	13.00		11.00	
	FX4CNF030	28,000	TDR&TXV	13.50		11.20	
	FX4CN(B,F)036	28,200	TDR&TXV	14.00		11.50	
	FE4ANF002	27,800	TDR&TXV	14.00		11.50	
	FE4ANF003	28,000	TDR&TXV	14.50		11.70	
	FE4ANF005	28,800	TDR&TXV	15.00		12.00	
	FF1ENP030	27,400	TDR&TXV	13.00		11.00	
	FF1ENP036	28,000	TDR&TXV	13.20		11.00	
	FV4BNF002	27,800	TDR&TXV	14.00		11.50	
	FV4BNF003	28,000	TDR&TXV	14.50		11.70	
	FV4BNF005	28,800	TDR&TXV	15.00		12.00	
	*CAP**3617A**	34,000	TXV		13.00	11.00	
	CAP**3614A**	33,000	TXV		13.00	11.00	
	CAP**3614A**	33,000	TDR&TXV	13.50		11.20	315(A,J)AV036070
	CAP**3617A**	33,600	TDR&TXV	14.00		11.50	355AAV042060
	CAP**3617A**	33,600	TDR&TXV	14.00		11.50	315(A,J)AV048090
	CAP**3621A**	34,000	TXV		13.00	11.00	
	CAP**3621A**	33,600	TDR&TXV	13.50		11.20	355AAV042080
	CAP**3621A**	33,800	TDR&TXV	14.00		11.50	315(A,J)AV060110
	CAP**4221A**	34,000	TXV		13.00	11.00	
	CAP**4221A**	33,800	TDR&TXV	14.00		11.50	355AAV042080
CAP**4221A**	34,000	TDR&TXV	14.00		11.50	315(A,J)AV060110	
CAP**4224A**	34,000	TXV		13.00	11.00		
CAP**4224A**	33,800	TDR&TXV	14.00		11.50	355AAV042040	
CAP**4224A**	34,000	TDR&TXV	14.50		11.70	315(A,J)AV066135	
CNPV*3617A**	33,800	TXV		13.00	11.00		
CNPV*3617A**	33,200	TDR&TXV	13.50		11.20	355AAV042060	
CNPV*3617A**	33,400	TDR&TXV	14.00		11.50	315(A,J)AV048090	
CNPV*3621A**	33,800	TXV		13.00	11.00		
CNPV*3621A**	33,600	TDR&TXV	13.00		11.00	355AAV042080	

See notes on pg. 14

123A

COMBINATION RATINGS CONTINUED

123A

Unit Size – Series	Indoor Model	Total Cap. BTUH	Factory Supplied Enhancement	SEER		EER	Furnace Model
				Standard Rating	TDR†		
036-A	CNPV*3621A**	33,800	TDR&TXV	13.50		11.20	315(A,J)AV060110
	CNPV*4221A**	34,000	TXV		13.00	11.00	
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	355AAV042080
	CNPV*4221A**	34,600	TDR&TXV	14.50		11.70	315(A,J)AV060110
	CNPV*4221A**	34,000	TXV		13.00	11.00	
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	355AAV042040
	CNPV*4221A**	34,400	TDR&TXV	14.00		11.50	355AAV042060
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CNPV*4221A**	34,000	TXV		13.00	11.00	
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	355AAV042040
	CNPV*4221A**	34,400	TDR&TXV	14.00		11.50	355AAV042060
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CNPV*4221A**	34,000	TXV		13.00	11.00	
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	355AAV042040
	CNPV*4221A**	34,400	TDR&TXV	14.00		11.50	355AAV042060
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CNPV*4221A**	34,000	TXV		13.00	11.00	
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	355AAV042040
	CNPV*4221A**	34,400	TDR&TXV	14.00		11.50	355AAV042060
	CNPV*4221A**	34,200	TDR&TXV	14.00		11.50	315(A,J)AV036070
	CNPV*4221A**	34,000	TXV		13.20	11.20	
	CNPV*4221A**	33,800	TDR&TXV	13.50		11.20	355AAV042040
	CNPV*4221A**	34,000	TDR&TXV	13.50		11.20	315(A,J)AV036070
	CNPV*4221A**	33,800	TDR&TXV	13.00		11.00	
	CNPV*4221A**	34,400	TDR&TXV	13.00		11.00	
	CNPV*4221A**	34,400	TDR&TXV	14.00		11.50	
	CNPV*4221A**	34,800	TDR&TXV	14.00		11.50	
	CNPV*4221A**	33,600	TDR&TXV	14.00		11.50	
	CNPV*4221A**	34,000	TDR&TXV	14.50		11.70	
	CNPV*4221A**	35,000	TDR&TXV	15.00		12.00	
	CNPV*4221A**	35,400	TDR&TXV	15.00		12.00	
	CNPV*4221A**	33,800	TDR&TXV	13.00		11.00	
	CNPV*4221A**	33,600	TDR&TXV	14.00		11.50	
	CNPV*4221A**	34,000	TDR&TXV	14.50		11.70	
	CNPV*4221A**	35,000	TDR&TXV	15.00		12.00	
CNPV*4221A**	35,400	TDR&TXV	15.00		12.00		
CNPV*4221A**	33,800	TDR&TXV	13.00		11.00		
CNPV*4221A**	33,600	TDR&TXV	14.00		11.50		
CNPV*4221A**	34,000	TDR&TXV	14.50		11.70		
CNPV*4221A**	35,000	TDR&TXV	15.00		12.00		
CNPV*4221A**	35,400	TDR&TXV	15.00		12.00		
CNPV*4221A**	41,000	TXV		13.00	11.00		
CNPV*4221A**	40,000	TDR&TXV	13.50		11.20	355AAV042080	
CNPV*4221A**	40,500	TDR&TXV	13.50		11.20	315(A,J)AV060110	
CNPV*4221A**	41,000	TXV		13.00	11.00		
CNPV*4221A**	40,000	TDR&TXV	13.50		11.20	355AAV042040	
CNPV*4221A**	40,500	TDR&TXV	14.00		11.50	315(A,J)AV066135	
CNPV*4221A**	41,000	TXV		13.00	11.00		
CNPV*4221A**	40,000	TDR&TXV	14.00		11.50	355AAV042060	
CNPV*4221A**	40,000	TDR&TXV	14.00		11.50	315(A,J)AV048090	
CNPV*4221A**	41,500	TXV		13.20	11.00		
CNPV*4221A**	40,500	TDR&TXV	13.50		11.20	355AAV042080	
CNPV*4221A**	41,000	TDR&TXV	14.00		11.50	315(A,J)AV060110	
CNPV*4221A**	41,500	TXV		13.20	11.00		
CNPV*4221A**	41,000	TDR&TXV	13.50		11.20	355AAV042040	
CNPV*4221A**	41,000	TDR&TXV	14.50		11.70	315(A,J)AV066135	
CNPV*4221A**	41,000	TXV		13.00	11.00		
CNPV*4221A**	40,000	TDR&TXV	13.50		11.20	355AAV042080	
CNPV*4221A**	40,000	TDR&TXV	14.00		11.50	315(A,J)AV060110	
CNPV*4221A**	40,500	TXV		13.20	11.00		
CNPV*4221A**	40,500	TDR&TXV	13.50		11.20	355AAV042080	
CNPV*4221A**	41,000	TDR&TXV	14.00		11.50	315(A,J)AV060110	
CNPV*4221A**	41,500	TXV		13.20	11.00		
CNPV*4221A**	41,000	TDR&TXV	13.50		11.20	355AAV042040	
CNPV*4221A**	40,500	TDR&TXV	14.50		11.70	315(A,J)AV066135	
CNPV*4221A**	41,000	TXV		13.00	11.00		
CNPV*4221A**	40,000	TDR&TXV	13.50		11.20	355AAV042040	
CNPV*4221A**	40,500	TDR&TXV	13.50		11.20	315(A,J)AV036070	

See notes on pg. 14

COMBINATION RATINGS CONTINUED

Unit Size – Series	Indoor Model	Total Cap. BTUH	Factory Supplied Enhancement	SEER		EER	Furnace Model
				Standard Rating	TDR†		
042-A	CNPH*4821A**	41,500	TXV		13.20	11.00	
	CNPH*4821A**	40,500	TDR&TXV	13.50		11.20	355AAV042040
	CNPH*4821A**	41,000	TDR&TXV	13.50		11.20	315(A,J)AV036070
	CNPF*4818A**	41,500	TXV		13.20	11.00	
	CSPH*4212A**	40,500	TXV		13.20	11.00	
	CSPH*4212A**	40,000	TDR&TXV	13.50		11.20	355AAV042040
	CSPH*4212A**	40,000	TDR&TXV	13.50		11.20	315(A,J)AV036070
	CSPH*4812A**	41,000	TXV		13.20	11.00	
	CSPH*4812A**	40,000	TDR&TXV	13.50		11.20	355AAV042040
	CSPH*4812A**	40,000	TDR&TXV	13.50		11.20	315(A,J)AV036070
	FY4ANF042	41,000	TDR&TXV	13.00		11.00	
	FY4ANF048	42,000	TDR&TXV	13.20		11.00	
	FX4CN(B,F)042	41,500	TDR&TXV	13.50		11.20	
	FX4CN(B,F)048	42,500	TDR&TXV	14.00		11.50	
	FE4ANF003	40,500	TDR&TXV	14.00		11.50	
	FE4ANF005	42,000	TDR&TXV	14.50		11.70	
	FE4ANB006	42,500	TDR&TXV	15.00		12.00	
	FV4BNF003	40,500	TDR&TXV	14.00		11.50	
	FV4BNF005	41,500	TDR&TXV	14.50		11.70	
	FV4BNB006	42,500	TDR&TXV	15.00		12.00	
	*CAP**4821A**	46,000	TXV		13.00	11.00	
	CAP**4817A**	45,500	TXV		13.00	11.00	
	CAP**4817A**	45,500	TDR&TXV	13.50		11.20	315(A,J)AV048090
	CAP**4821A**	45,000	TDR&TXV	13.20		11.00	355AAV060080
	CAP**4821A**	45,000	TDR&TXV	13.65		11.40	355AAV060100
	CAP**4821A**	45,000	TDR&TXV	13.50		11.20	315(A,J)AV060110
	CAP**4824A**	46,000	TXV		13.00	11.00	
	CAP**4824A**	45,000	TDR&TXV	13.50		11.20	355AAV060120
CAP**4824A**	45,500	TDR&TXV	13.50		11.20	315(A,J)AV066135	
CAP**6021A**	47,000	TXV		13.20	11.00		
CAP**6021A**	46,000	TDR&TXV	13.50		11.20	355AAV060080	
CAP**6021A**	47,500	TDR&TXV	13.50		11.20	315(A,J)AV060110	
CAP**6024A**	47,000	TXV		13.20	11.00		
CAP**6024A**	46,000	TDR&TXV	14.00		11.50	355AAV060120	
CAP**6024A**	46,500	TDR&TXV	14.00		11.50	315(A,J)AV066135	
CNPV*4221A**	44,500	TXV		13.00	10.95		
CNPV*4221A**	44,500	TDR&TXV	13.20		11.00	355AAV060080	
CNPV*4221A**	44,500	TDR&TXV	13.50		11.20	315(A,J)AV060110	
CNPV*4821A**	46,000	TXV		13.00	11.00		
CNPV*4821A**	45,000	TDR&TXV	13.20		11.00	355AAV060080	
CNPV*4821A**	45,000	TDR&TXV	13.50		11.20	315(A,J)AV060110	
CNPV*4824A**	46,000	TXV		13.00	11.00		
CNPV*4824A**	45,500	TDR&TXV	13.50		11.20	355AAV060120	
CNPV*4824A**	45,500	TDR&TXV	13.50		11.20	315(A,J)AV066135	
CNPV*6024A**	47,000	TXV		13.20	11.00		
CNPV*6024A**	46,000	TDR&TXV	13.50		11.20	355AAV060120	
CNPV*6024A**	46,000	TDR&TXV	14.00		11.50	315(A,J)AV066135	
CNPH*4821A**	46,000	TXV		13.00	11.00		
CNPH*4821A**	45,000	TDR&TXV	13.20		11.00	355AAV060080	
CNPH*4821A**	45,000	TDR&TXV	13.50		11.20	355AAV060100	
CNPH*4821A**	45,000	TDR&TXV	13.50		11.20	315(A,J)AV048090	
CNPH*4821A**	45,500	TDR&TXV	13.50		11.20	315(A,J)AV060110	
CNPH*6024A**	47,000	TXV		13.20	11.00		
CNPH*6024A**	46,000	TDR&TXV	13.50		11.20	355AAV060080	
CNPH*6024A**	46,000	TDR&TXV	13.50		11.20	355AAV060100	
CNPH*6024A**	46,000	TDR&TXV	13.50		11.20	315(A,J)AV048090	
CNPH*6024A**	46,000	TDR&TXV	13.50		11.20	315(A,J)AV060110	
CNPF*4818A**	45,000	TXV		13.00	11.00		

See notes on pg. 14

123A

COMBINATION RATINGS CONTINUED

123A

Unit Size – Series	Indoor Model	Total Cap. BTUH	Factory Supplied Enhancement	SEER		EER	Furnace Model
				Standard Rating	TDR†		
048–A	CSPH*4812A**	45,500	TXV		13.00	11.00	
	CSPH*4812A**	44,500	TDR&TXV	13.20		11.00	355AAV060080
	CSPH*4812A**	44,500	TDR&TXV	13.50		11.20	315(A,J)AV048090
	CSPH*6012A**	46,000	TXV		13.20	11.00	
	CSPH*6012A**	45,000	TDR&TXV	13.50		11.20	355AAV060080
	CSPH*6012A**	45,000	TDR&TXV	13.50		11.20	315(A,J)AV048090
	FX4CN(B,F)048	47,000	TDR&TXV	13.50		11.20	
	FX4CN(B,F)060	47,500	TDR&TXV	14.00		11.50	
	FE4ANF005	46,500	TDR&TXV	14.00		11.50	
	FE4ANB006	47,000	TDR&TXV	14.50		11.70	
	FV4BNF005	46,500	TDR&TXV	14.00		11.50	
	FV4BNB006	47,000	TDR&TXV	14.50		11.70	
	FY4ANF048	46,000	TDR&TXV	13.00		11.00	
	FY4ANB060	46,500	TDR&TXV	13.20		11.00	
	*CAP**6024A**	57,500	TXV		13.00	11.00	
	060–A	CAP**6021A**	56,500	TXV		13.00	11.00
CAP**6021A**		56,000	TDR&TXV	13.20		11.00	315(A,J)AV060110
CAP**6024A**		56,500	TDR&TXV	13.20		11.00	315(A,J)AV066135
CAP**6024A**		56,500	TDR&TXV	13.50		11.20	315(A,J)AV066155
CNPV*6024A**		57,000	TXV		13.00	11.00	
CNPV*6024A**		56,000	TDR&TXV	13.50		11.00	315(A,J)AV066135
CNPV*6024A**		56,500	TDR&TXV	13.50		11.20	315(A,J)AV066155
CNPH*6024A**		56,000	TXV		13.00	11.00	
CNPH*6024A**		56,000	TDR&TXV	13.50		11.20	315(A,J)AV066135
CNPH*6024A**		56,500	TDR&TXV	13.50		11.20	315(A,J)AV066155
CSPH*6012A**		56,500	TXV		13.00	11.00	
CSPH*6012A**		55,500	TDR&TXV	13.20		11.00	315(A,J)AV060110
CSPH*6012A**		55,500	TDR&TXV	13.50		11.20	315(A,J)AV066135
CSPH*6012A**		55,500	TDR&TXV	13.50		11.20	315(A,J)AV066155
FX4CN(B,F)060		58,000	TDR&TXV	13.20		11.00	
FE4ANB006		57,000	TDR&TXV	13.50		11.20	
FV4BNB006	57,000	TDR&TXV	13.50		11.20		
FY4ANB060	56,500	TDR&TXV	13.00		11.00		

* Tested combination

† In most cases, only 1 method should be used to achieve TDR function. Using more than 1 method in a system may cause degradation in performance. Use either the accessory Time–Delay Relay KAATD0101TDR or a furnace equipped with TDR. Most Bryant furnaces are equipped with TDR.

EER — Energy Efficiency Ratio

SEER — Seasonal Energy Efficiency Ratio

TDR — Time–Delay Relay

TXV — Thermostatic Expansion Valve

NOTES:

1. Ratings are net values reflecting the effects of circulating fan motor heat. Supplemental electric heat is not included.
2. Tested outdoor/indoor combinations have been tested in accordance with DOE test procedures for central air conditioners. Ratings for other combinations are determined under DOE computer simulation procedures.
3. Determine actual CFM values obtainable for your system by referring to fan performance data in fan coil or furnace coil literature.
4. Do not apply with capillary tube coils as performance and reliability are significantly affected.

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtu/h†	Total System KW**	Sens‡	Capacity MBtu/h†	Total System KW**	Sens‡	Capacity MBtu/h†	Total System KW**	Sens‡	Capacity MBtu/h†	Total System KW**	Sens‡	Capacity MBtu/h†	Total System KW**	Sens‡	Capacity MBtu/h†	Total System KW**	Sens‡
CFM	EWB																		
123ANA018 – A Outdoor Section With CAP**1814A** Indoor Section																			
525	72	20.46	10.76	1.21	19.55	10.41	1.36	18.59	10.05	1.53	17.62	9.69	1.71	16.57	9.30	1.91	15.40	8.88	2.13
	67	18.79	13.26	1.22	17.95	12.90	1.37	17.05	12.52	1.53	16.12	12.14	1.72	15.13	11.74	1.92	14.03	11.30	2.13
	62	17.27	15.73	1.22	16.49	15.36	1.37	15.68	14.97	1.54	14.83	14.55	1.72	14.00	14.00	1.92	13.15	13.15	2.13
	57	16.78	16.78	1.23	16.15	16.15	1.37	15.48	15.48	1.54	14.77	14.77	1.72	14.00	14.00	1.92	13.15	13.15	2.13
600	72	20.79	11.28	1.24	19.83	10.92	1.39	18.83	10.55	1.56	17.83	10.19	1.74	16.76	9.80	1.94	15.55	9.37	2.16
	67	19.11	14.10	1.25	18.23	13.73	1.40	17.30	13.36	1.56	16.35	12.97	1.74	15.33	12.57	1.94	14.20	12.12	2.16
	62	17.66	16.88	1.25	16.87	16.49	1.40	16.06	16.06	1.56	15.32	15.32	1.75	14.51	14.51	1.94	13.61	13.61	2.16
	57	17.46	17.46	1.25	16.79	16.79	1.40	16.07	16.07	1.56	15.32	15.32	1.75	14.51	14.51	1.94	13.61	13.61	2.16
675	72	21.03	11.77	1.27	20.02	11.40	1.42	18.99	11.03	1.58	17.97	10.67	1.77	16.88	10.28	1.97	15.65	9.85	2.18
	67	19.33	14.90	1.27	18.43	14.54	1.42	17.48	14.15	1.59	16.51	13.77	1.77	15.48	13.35	1.97	14.33	12.89	2.19
	62	18.01	17.91	1.28	17.30	17.30	1.43	16.54	16.54	1.59	15.76	15.76	1.77	14.92	14.92	1.97	13.97	13.97	2.19
	57	18.01	18.01	1.28	17.30	17.30	1.43	16.55	16.55	1.59	15.76	15.76	1.77	14.92	14.92	1.97	13.97	13.97	2.19

Multipliers for Determining the Performance With Other Indoor Sections

Cooling Indoor Model	Capacity	Power	Furnace Model
*CAP**1814A**	1.00	1.00	
CAP**2414A**	1.01	1.01	
CAP**2417A**	1.01	1.01	
CNPF*2418A**	1.00	1.00	
CNPH*2417A**	1.00	1.00	
CNPV*1814A**	0.99	0.99	
CNPV*2414A**	1.00	1.00	
CNPV*2417A**	1.00	1.00	
CSPH*2412A**	0.97	0.97	
FE4ANF002	1.02	0.93	
FF1ENP018	0.99	0.99	
FF1ENP024	1.01	1.01	
FV4BNF002	1.02	0.93	
FX4CNF018	1.01	0.95	
FX4CNF024	1.02	0.96	
FY4ANF018	0.99	0.99	
FY4ANF024	1.00	1.00	

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**1814A**	0.98	0.92	315(A,J)AV036070
CAP**2414A**	1.00	0.94	315(A,J)AV036070
CNPH*2417A**	0.99	0.93	315(A,J)AV036070
CNPV*1814A**	0.98	0.92	315(A,J)AV036070
CNPV*2414A**	0.99	0.93	315(A,J)AV036070
CSPH*2412A**	0.95	0.89	315(A,J)AV036070
CAP**2417A**	1.01	0.95	315(A,J)AV048090
CNPH*2417A**	0.99	0.93	315(A,J)AV048090
CNPV*2417A**	0.99	0.93	315(A,J)AV048090
CSPH*2412A**	0.95	0.90	315(A,J)AV048090
CNPH*2417A**	0.99	0.93	355AAV042040
CSPH*2412A**	0.95	0.90	355AAV042040
CAP**2417A**	1.00	0.94	355AAV042060
CNPH*2417A**	0.99	0.93	355AAV042060
CNPV*2417A**	0.99	0.93	355AAV042060
CSPH*2412A**	0.95	0.90	355AAV042060
CNPH*2417A**	0.99	0.93	355AAV042080
CSPH*2412A**	0.95	0.90	355AAV042080

See notes on pg. 21

123A

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**
Total	Sens ‡																		
123ANA024—A Outdoor Section With CAP**2414A** Indoor Section																			
700	72	27.11	14.29	1.61	25.97	13.86	1.81	24.75	13.40	2.03	23.47	12.92	2.28	22.09	12.41	2.55	20.55	11.85	2.84
	67	24.89	17.62	1.61	23.81	17.16	1.81	22.66	16.68	2.03	21.45	16.19	2.28	20.15	15.66	2.55	18.73	15.09	2.85
	62	22.86	20.91	1.61	21.86	20.44	1.81	20.81	19.93	2.04	19.72	19.39	2.28	18.65	18.65	2.56	17.57	17.57	2.86
	57	22.24	22.24	1.61	21.43	21.43	1.82	20.56	20.56	2.04	19.64	19.64	2.28	18.65	18.65	2.56	17.57	17.57	2.86
800	72	27.54	14.98	1.64	26.35	14.54	1.84	25.08	14.08	2.06	23.76	13.60	2.31	22.34	13.09	2.58	20.75	12.52	2.88
	67	25.31	18.74	1.64	24.19	18.29	1.85	23.00	17.81	2.07	21.75	17.31	2.31	20.42	16.77	2.59	18.96	16.19	2.88
	62	23.37	22.46	1.65	22.36	21.95	1.85	21.35	21.35	2.07	20.38	20.38	2.32	19.33	19.33	2.59	18.18	18.18	2.89
	57	23.14	23.14	1.65	22.28	22.28	1.85	21.36	21.36	2.07	20.38	20.38	2.32	19.33	19.33	2.59	18.18	18.18	2.89
900	72	27.83	15.64	1.68	26.61	15.19	1.88	25.31	14.72	2.10	23.96	14.25	2.34	22.50	13.73	2.61	20.87	13.16	2.91
	67	25.61	19.83	1.68	24.46	19.37	1.88	23.25	18.88	2.10	21.97	18.37	2.35	20.61	17.83	2.62	19.12	17.24	2.92
	62	23.85	23.85	1.68	22.96	22.96	1.88	22.00	22.00	2.10	20.98	20.98	2.35	19.87	19.87	2.62	18.66	18.66	2.92
	57	23.87	23.87	1.68	22.97	22.97	1.88	22.00	22.00	2.10	20.98	20.98	2.35	19.87	19.87	2.62	18.66	18.66	2.92

Multipliers for Determining the Performance With Other Indoor Sections

Cooling Indoor Model	Capacity	Power	Furnace Model
*CAP**2414A**	1.00	1.00	
CAP**2417A**	0.99	0.99	
CAP**3014A**	1.00	1.00	
CAP**3017A**	1.00	1.00	
CNPF*2418A**	0.98	0.98	
CNPH*2417A**	0.98	0.98	
CNPH*3017A**	0.99	0.99	
CNPV*2414A**	0.98	0.98	
CNPV*2417A**	0.98	0.98	
CNPV*3014A**	0.99	0.99	
CNPV*3017A**	0.99	0.99	
CSPH*2412A**	0.96	0.96	
CSPH*3012A**	0.96	0.96	
FE4ANF002	1.00	0.94	
FE4ANF003	1.00	0.94	
FF1ENP024	0.98	0.98	
FF1ENP030	0.98	0.98	
FV4BNF002	1.00	0.94	
FV4BNF003	1.00	0.92	
FX4CNF024	1.00	0.96	
FX4CNF030	1.01	0.96	
FY4ANF024	0.98	0.98	
FY4ANF030	0.99	0.99	

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**2414A**	0.98	0.94	315(A,J)AV036070
CAP**3014A**	0.99	0.95	315(A,J)AV036070
CNPH*2417A**	0.97	0.93	315(A,J)AV036070
CNPH*3017A**	0.98	0.92	315(A,J)AV036070
CNPV*2414A**	0.97	0.93	315(A,J)AV036070
CNPV*3014A**	0.98	0.97	315(A,J)AV036070
CSPH*2412A**	0.95	0.91	315(A,J)AV036070
CSPH*3012A**	0.95	0.89	315(A,J)AV036070
CAP**2417A**	0.98	0.92	315(A,J)AV048090
CAP**3017A**	0.99	0.93	315(A,J)AV048090
CNPV*2417A**	0.97	0.93	315(A,J)AV048090
CNPV*3017A**	0.98	0.92	315(A,J)AV048090
CSPH*2412A**	0.95	0.89	315(A,J)AV048090
CSPH*3012A**	0.96	0.90	315(A,J)AV048090
CSPH*2412A**	0.95	0.91	315(A,J)AV060110
CSPH*3012A**	0.96	0.90	315(A,J)AV060110
CSPH*2412A**	0.95	0.91	315(A,J)AV066135
CSPH*3012A**	0.96	0.90	315(A,J)AV066135
CSPH*3012A**	0.96	0.90	315(A,J)AV066155
CNPH*2417A**	0.97	0.93	355AAV042040
CNPH*3017A**	0.98	0.92	355AAV042040
CSPH*2412A**	0.95	0.91	355AAV042040
CSPH*3012A**	0.96	0.90	355AAV042040
CAP**2417A**	0.98	0.94	355AAV042060
CAP**3017A**	0.99	0.93	355AAV042060
CNPV*2417A**	0.97	0.93	355AAV042060
CNPV*3017A**	0.98	0.92	355AAV042060
CSPH*2412A**	0.95	0.91	355AAV042060
CSPH*3012A**	0.95	0.89	355AAV042060
CSPH*3012A**	0.96	0.90	355AAV042080
CSPH*3012A**	0.95	0.89	355AAV060080
CSPH*3012A**	0.96	0.90	355AAV060100
CSPH*3012A**	0.95	0.89	355AAV060120

See notes on pg. 21

123A

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**
Total	Sens ‡	Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡				
123ANA030—A Outdoor Section With CAP**3014A** Indoor Section																			
875	72	33.13	17.60	2.01	31.70	17.06	2.23	30.20	16.49	2.47	28.59	15.90	2.75	26.87	15.27	3.06	25.01	14.60	3.38
	67	30.12	21.64	2.01	28.78	21.09	2.23	27.37	20.50	2.48	25.87	19.89	2.76	24.27	19.25	3.07	22.59	18.58	3.42
	62	27.50	25.68	2.01	26.29	25.09	2.23	25.03	24.47	2.48	23.75	23.75	2.77	22.56	22.56	3.08	21.27	21.27	3.43
	57	26.93	26.93	2.01	25.94	25.94	2.24	24.89	24.89	2.48	23.76	23.76	2.77	22.56	22.56	3.08	21.27	21.27	3.43
1000	72	33.69	18.46	2.05	32.21	17.92	2.27	30.64	17.34	2.52	28.98	16.74	2.80	27.20	16.10	3.11	25.32	15.44	3.45
	67	30.64	23.04	2.05	29.26	22.48	2.27	27.80	21.89	2.52	26.25	21.27	2.80	24.61	20.61	3.12	22.87	19.92	3.46
	62	28.16	27.55	2.06	26.95	26.95	2.28	25.86	25.86	2.53	24.67	24.67	2.81	23.39	23.39	3.12	22.02	22.02	3.47
	57	28.03	28.03	2.06	26.98	26.98	2.28	25.86	25.86	2.53	24.67	24.67	2.81	23.39	23.39	3.12	22.02	22.02	3.47
1125	72	34.09	19.27	2.10	32.57	18.72	2.32	30.96	18.14	2.56	29.26	17.54	2.84	27.43	16.89	3.15	25.50	16.22	3.49
	67	31.03	24.36	2.10	29.61	23.80	2.32	28.12	23.20	2.57	26.54	22.57	2.85	24.86	21.90	3.16	23.10	21.19	3.50
	62	28.94	28.94	2.10	27.83	27.83	2.32	26.66	26.66	2.57	25.40	25.40	2.85	24.06	24.06	3.16	22.61	22.61	3.48
	57	28.94	28.94	2.10	27.83	27.83	2.32	26.66	26.66	2.57	25.41	25.41	2.85	24.06	24.06	3.16	22.62	22.62	3.51

Multipliers for Determining the Performance With Other Indoor Sections

Cooling Indoor Model	Capacity	Power	Furnace Model
*CAP**3014A**	1.00	1.00	
CAP**3017A**	1.00	1.00	
CAP**3614A**	1.00	1.00	
CAP**3617A**	1.00	1.00	
CAP**3621A**	1.00	1.00	
CNPF*3618A**	0.99	0.99	
CNPH*3017A**	0.99	0.99	
CNPH*3617A**	0.99	0.99	
CNPV*3014A**	0.99	0.99	
CNPV*3017A**	0.99	0.99	
CNPV*3617A**	0.99	0.99	
CNPV*3621A**	0.99	0.99	
CSPH*3012A**	0.96	0.96	
CSPH*3612A**	0.98	0.98	
FE4ANF002	0.99	0.95	
FE4ANF003	1.00	0.94	
FE4ANF005	1.03	0.94	
FF1ENP030	0.98	0.98	
FF1ENP036	1.00	1.00	
FV4BNF002	0.99	0.95	
FV4BNF003	1.00	0.94	
FV4BNF005	1.03	0.94	
FX4CN(B,F)036	1.01	0.96	
FX4CNF030	1.00	0.98	
FY4ANF030	0.99	0.99	
FY4ANF036	0.99	0.99	

See notes on pg. 21

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**3014A**	0.99	0.97	315(A,J)AV036070
CAP**3614A**	0.99	0.94	315(A,J)AV036070
CNPH*3017A**	0.98	0.94	315(A,J)AV036070
CNPH*3617A**	0.98	0.94	315(A,J)AV036070
CNPV*3014A**	0.98	0.96	315(A,J)AV036070
CSPH*3012A**	0.96	0.92	315(A,J)AV036070
CSPH*3612A**	0.97	0.93	315(A,J)AV036070
CAP**3017A**	0.99	0.94	315(A,J)AV048090
CAP**3617A**	0.99	0.95	315(A,J)AV048090
CNPV*3017A**	0.98	0.94	315(A,J)AV048090
CNPV*3617A**	0.98	0.94	315(A,J)AV048090
CAP**3621A**	0.99	0.95	315(A,J)AV060110
CNPV*3621A**	0.99	0.94	315(A,J)AV060110
CNPH*3017A**	0.98	0.96	355AAV042040
CNPH*3617A**	0.98	0.96	355AAV042040
CSPH*3012A**	0.96	0.94	355AAV042040
CSPH*3612A**	0.97	0.93	355AAV042040
CAP**3017A**	0.99	0.94	355AAV042060
CAP**3617A**	0.99	0.94	355AAV042060
CNPV*3017A**	0.98	0.94	355AAV042060
CNPV*3617A**	0.98	0.94	355AAV042060
CAP**3621A**	0.99	0.95	355AAV042080
CNPV*3621A**	0.98	0.94	355AAV042080

123A

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																							
		75				85				95				105				115				125			
		CFM	EWB	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**				
Total	Sens ‡			Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡								
123ANA036—A Outdoor Section With CAP**3617A** Indoor Section																									
1050	72	40.12	21.34	2.48	38.42	20.70	2.74	36.61	20.02	3.03	34.70	19.31	3.35	32.62	18.55	3.71	30.32	17.72	4.09						
	67	36.62	26.34	2.47	35.03	25.67	2.73	33.34	24.97	3.02	31.55	24.24	3.34	29.62	23.47	3.70	27.50	22.62	4.09						
	62	33.54	31.31	2.46	32.11	30.61	2.72	30.61	29.86	3.01	29.06	29.06	3.34	27.62	27.62	3.70	25.99	25.99	4.09						
1200	57	32.88	32.88	2.46	31.70	31.70	2.72	30.44	30.44	3.01	29.09	29.09	3.34	27.63	27.63	3.70	26.00	26.00	4.09						
	72	40.72	22.34	2.54	38.96	21.69	2.80	37.09	21.00	3.09	35.11	20.28	3.41	32.97	19.51	3.76	30.60	18.67	4.15						
	67	37.19	27.96	2.53	35.54	27.28	2.79	33.80	26.58	3.08	31.96	25.85	3.40	29.98	25.06	3.76	27.81	24.20	4.15						
	62	34.30	33.50	2.52	32.84	32.84	2.78	31.55	31.55	3.07	30.12	30.12	3.40	28.56	28.56	3.75	26.83	26.83	4.14						
1350	57	34.15	34.15	2.52	32.89	32.89	2.78	31.55	31.55	3.07	30.12	30.12	3.40	28.56	28.56	3.75	26.83	26.83	4.14						
	72	41.16	23.27	2.60	39.34	22.61	2.86	37.42	21.92	3.14	35.40	21.20	3.47	33.21	20.42	3.82	30.78	19.57	4.21						
	67	37.62	29.51	2.59	35.93	28.83	2.85	34.15	28.12	3.14	32.27	27.38	3.46	30.25	26.57	3.81	28.05	25.67	4.20						
	62	35.18	35.18	2.58	33.86	33.86	2.84	32.45	32.45	3.13	30.95	30.95	3.46	29.31	29.31	3.81	27.50	27.50	4.20						
57	35.19	35.19	2.58	33.86	33.86	2.84	32.46	32.46	3.13	30.95	30.95	3.46	29.31	29.31	3.81	27.50	27.50	4.20							

Multippliers for Determining the Performance With Other Indoor Sections

Cooling Indoor Model	Capacity	Power	Furnace Model
*CAP**3617A**	1.00	1.00	
CAP**3614A**	0.97	0.97	
CAP**3621A**	1.00	1.00	
CAP**4221A**	1.00	1.00	
CAP**4224A**	1.00	1.00	
CNPF*3618A**	0.99	0.99	
CNPH*3617A**	0.99	0.99	
CNPH*4221A**	1.00	1.00	
CNPV*3617A**	0.99	0.99	
CNPV*3621A**	0.99	0.99	
CNPV*4221A**	1.00	1.00	
CSPH*3612A**	0.99	0.99	
CSPH*4212A**	0.99	0.98	
FE4ANB006	1.04	0.95	
FE4ANF002	0.99	0.95	
FE4ANF003	1.00	0.94	
FE4ANF005	1.03	0.94	
FF1ENP036	0.99	0.99	
FV4BNB006	1.04	0.95	
FV4BNF002	0.99	0.95	
FV4BNF003	1.00	0.94	
FV4BNF005	1.03	0.94	
FX4CN(B,F)036	1.01	0.97	
FX4CN(B,F)042	1.02	0.98	
FY4ANF036	0.99	0.99	
FY4ANF042	1.01	1.01	

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**3614A**	0.97	0.95	315(A,J)AV036070
CNPH*3617A**	0.98	0.96	315(A,J)AV036070
CNPH*4221A**	1.01	0.96	315(A,J)AV036070
CSPH*3612A**	0.98	0.93	315(A,J)AV036070
CSPH*4212A**	1.00	0.98	315(A,J)AV036070
CAP**3617A**	0.99	0.95	315(A,J)AV048090
CNPV*3617A**	0.98	0.94	315(A,J)AV048090
CAP**3621A**	0.99	0.95	315(A,J)AV060110
CAP**4221A**	1.00	0.96	315(A,J)AV060110
CNPV*3621A**	0.99	0.98	315(A,J)AV060110
CNPV*4221A**	1.02	0.96	315(A,J)AV060110
CAP**4224A**	1.00	0.94	315(A,J)AV066135
CAP**4224A**	0.99	0.95	355AAV042040
CNPH*3617A**	0.98	0.96	355AAV042040
CNPH*4221A**	1.01	0.96	355AAV042040
CSPH*3612A**	0.98	0.93	355AAV042040
CSPH*4212A**	0.99	0.98	355AAV042040
CAP**3617A**	0.99	0.95	355AAV042060
CNPH*4221A**	1.01	0.97	355AAV042060
CNPV*3617A**	0.98	0.96	355AAV042060
CAP**3621A**	0.99	0.97	355AAV042080
CAP**4221A**	0.99	0.95	355AAV042080
CNPV*3621A**	0.99	0.99	355AAV042080
CNPV*4221A**	1.01	0.96	355AAV042080

See notes on pg. 21

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		CFM	EWB	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	
Total	Sens ‡			Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡					
123ANA042-A Outdoor Section With CAP**4221A** Indoor Section																			
1225	72	48.51	25.52	3.33	46.40	24.71	3.68	44.17	23.86	4.08	41.83	22.99	4.51	39.30	22.05	4.99	36.50	21.03	5.51
	67	44.49	31.40	3.31	42.53	30.57	3.66	40.46	29.71	4.06	38.30	28.81	4.50	35.96	27.87	4.98	33.41	26.84	5.51
	62	40.85	37.25	3.29	39.08	36.40	3.65	37.24	35.50	4.04	35.33	34.54	4.48	33.39	33.39	4.97	31.44	31.44	5.50
1400	57	39.76	39.76	3.29	38.32	38.32	3.64	36.79	36.79	4.04	35.17	35.17	4.48	33.41	33.41	4.97	31.45	31.45	5.50
	72	49.22	26.65	3.40	47.02	25.82	3.76	44.72	24.97	4.15	42.30	24.08	4.59	39.69	23.14	5.07	36.79	22.10	5.59
	67	45.18	33.25	3.38	43.15	32.40	3.74	41.00	31.53	4.13	38.76	30.63	4.57	36.37	29.68	5.05	33.74	28.63	5.58
	62	41.71	39.81	3.37	39.92	38.90	3.72	38.04	38.04	4.12	36.38	36.38	4.56	34.50	34.50	5.05	32.41	32.41	5.58
1575	57	41.28	41.28	3.37	39.74	39.74	3.72	38.11	38.11	4.12	36.38	36.38	4.56	34.50	34.50	5.05	32.41	32.41	5.58
	72	49.76	27.73	3.48	47.49	26.90	3.84	45.12	26.04	4.23	42.63	25.14	4.67	39.95	24.19	5.14	36.99	23.14	5.66
	67	45.71	35.04	3.46	43.61	34.19	3.82	41.42	33.32	4.21	39.13	32.41	4.65	36.68	31.44	5.13	33.99	30.36	5.65
	62	42.55	42.13	3.45	40.89	40.89	3.80	39.17	39.17	4.20	37.34	37.34	4.64	35.37	35.37	5.12	33.16	33.16	5.65
57	42.52	42.52	3.45	40.89	40.89	3.80	39.17	39.17	4.20	37.35	37.35	4.64	35.37	35.37	5.12	33.16	33.16	5.65	

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Model	Capacity	Power	Furnace Model
*CAP**4221A**	1.00	1.00	
CAP**4224A**	1.00	1.00	
CAP**4817A**	0.98	0.98	
CAP**4821A**	1.01	1.01	
CAP**4824A**	1.01	1.01	
CNPF*4818A**	1.01	1.01	
CNPH*4221A**	1.00	1.00	
CNPH*4821A**	1.01	1.01	
CNPV*4221A**	1.00	1.00	
CNPV*4821A**	0.99	0.99	
CNPV*4824A**	1.01	1.01	
CSPH*4212A**	0.99	0.99	
CSPH*4812A**	1.00	1.00	
FE4ANB006	1.04	0.95	
FE4ANF003	0.99	0.94	
FE4ANF005	1.02	0.96	
FV4BNB006	1.04	0.95	
FV4BNF003	0.99	0.94	
FV4BNF005	1.01	0.95	
FX4CN(B,F)042	1.01	0.99	
FX4CN(B,F)048	1.04	0.99	
FY4ANF042	1.00	1.00	
FY4ANF048	1.02	1.02	

See notes on pg. 21

Indoor Model	Capacity	Power	Furnace Model
CNPH*4221A**	0.99	0.97	315(A,J)AV036070
CNPH*4821A**	1.00	0.98	315(A,J)AV036070
CSPH*4212A**	0.98	0.96	315(A,J)AV036070
CSPH*4812A**	0.98	0.96	315(A,J)AV036070
CAP**4817A**	0.98	0.93	315(A,J)AV048090
CAP**4221A**	0.99	0.97	315(A,J)AV060110
CAP**4821A**	1.00	0.96	315(A,J)AV060110
CNPV*4221A**	0.98	0.93	315(A,J)AV060110
CNPV*4821A**	1.00	0.96	315(A,J)AV060110
CAP**4224A**	0.99	0.94	315(A,J)AV066135
CAP**4824A**	1.00	0.94	315(A,J)AV066135
CNPV*4824A**	0.99	0.93	315(A,J)AV066135
CAP**4224A**	0.98	0.96	355AAV042040
CAP**4824A**	1.00	0.98	355AAV042040
CNPH*4221A**	0.98	0.96	355AAV042040
CNPH*4821A**	0.99	0.97	355AAV042040
CNPV*4824A**	1.00	0.98	355AAV042040
CSPH*4212A**	0.98	0.96	355AAV042040
CSPH*4812A**	0.98	0.96	355AAV042040
CAP**4817A**	0.98	0.93	355AAV042060
CAP**4221A**	0.98	0.96	355AAV042080
CAP**4821A**	0.99	0.97	355AAV042080

123A

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**	Capacity MBtu/h†	Sens ‡	Total System KW**
Total	Sens ‡																		
123ANA048—A Outdoor Section With CAP**4821A** Indoor Section																			
1400	72	55.04	28.49	3.35	52.62	27.54	3.75	50.08	26.56	4.20	47.38	25.54	4.72	44.49	24.45	5.30	41.25	23.26	6.01
	67	49.86	34.52	3.35	47.63	33.55	3.75	45.27	32.56	4.21	42.77	31.51	4.73	40.10	30.41	5.33	37.08	29.19	6.08
	62	45.26	40.60	3.35	43.30	39.77	3.76	41.26	38.91	4.22	39.15	38.04	4.74	37.27	37.27	5.34	35.05	35.05	6.09
	57	44.65	44.65	3.35	42.99	42.99	3.76	41.23	41.23	4.22	39.35	39.35	4.74	37.33	37.33	5.34	35.06	35.06	6.09
1600	72	56.06	29.65	3.42	53.54	28.69	3.82	50.89	27.69	4.27	48.09	26.65	4.79	45.09	25.55	5.36	41.76	24.34	6.06
	67	50.79	36.35	3.42	48.45	35.38	3.82	46.00	34.36	4.28	43.40	33.30	4.80	40.63	32.17	5.39	37.50	30.93	6.14
	62	46.36	43.45	3.42	44.40	42.66	3.83	42.52	41.92	4.17	40.77	40.77	4.81	38.63	38.63	5.40	36.19	36.19	6.15
	57	46.41	46.41	3.42	44.64	44.64	3.83	42.77	42.77	4.28	40.78	40.78	4.81	38.63	38.63	5.40	36.19	36.19	6.15
1800	72	56.83	30.71	3.49	54.22	29.73	3.89	51.49	28.72	4.34	48.61	27.66	4.85	45.53	26.54	5.43	42.11	25.32	6.12
	67	51.48	38.05	3.49	49.06	37.05	3.89	46.53	36.02	4.35	43.86	34.94	4.87	41.00	33.80	5.46	37.80	32.58	6.20
	62	47.45	46.27	3.50	45.69	45.69	3.90	44.03	44.03	4.36	41.94	41.94	4.88	39.69	39.69	5.47	37.12	37.12	6.21
	57	47.87	47.87	3.49	46.01	46.01	3.90	44.04	44.04	4.36	41.95	41.95	4.88	39.69	39.69	5.47	37.13	37.13	6.21

Multipliers for Determining the Performance With Other Indoor Sections

Cooling Indoor Model	Capacity	Power	Furnace Model
*CAP**4821A**	1.00	1.00	
CAP**4817A**	0.99	0.99	
CAP**4824A**	1.00	1.00	
CAP**6021A**	1.02	1.02	
CAP**6024A**	1.02	1.02	
CNPF*4818A**	0.98	0.98	
CNPH*4821A**	1.00	1.00	
CNPH*6024A**	1.02	1.02	
CNPV*4221A**	0.97	0.97	
CNPV*4821A**	1.00	1.00	
CNPV*4824A**	1.00	1.00	
CNPV*6024A**	1.02	1.02	
CSPH*4812A**	0.99	0.99	
CSPH*6012A**	1.00	1.00	
FE4ANB006	1.02	0.96	
FE4ANF005	1.01	0.97	
FV4BNB006	1.02	0.96	
FV4BNF005	1.01	0.97	
FX4CN(B,F)048	1.02	1.00	
FX4CN(B,F)060	1.03	0.99	
FY4ANB060	1.01	1.01	
FY4ANF048	1.00	1.00	

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**4817A**	0.99	0.97	315(A,J)AV048090
CNPH*4821A**	0.98	0.96	315(A,J)AV048090
CNPH*6024A**	1.00	0.98	315(A,J)AV048090
CSPH*4812A**	0.97	0.95	315(A,J)AV048090
CSPH*6012A**	0.98	0.96	315(A,J)AV048090
CAP**4821A**	0.98	0.96	315(A,J)AV060110
CAP**6021A**	1.03	1.01	315(A,J)AV060110
CNPH*4821A**	0.99	0.97	315(A,J)AV060110
CNPH*6024A**	1.00	0.98	315(A,J)AV060110
CNPV*4221A**	0.97	0.95	315(A,J)AV060110
CNPV*4821A**	0.98	0.96	315(A,J)AV060110
CAP**4824A**	0.99	0.97	315(A,J)AV066135
CAP**6024A**	1.01	0.97	315(A,J)AV066135
CNPV*4824A**	0.99	0.97	315(A,J)AV066135
CNPV*6024A**	1.00	0.96	315(A,J)AV066135
CAP**4821A**	0.98	0.98	355AAV060080
CAP**6021A**	1.00	0.98	355AAV060080
CNPH*4821A**	0.98	0.98	355AAV060080
CNPH*6024A**	1.00	0.98	355AAV060080
CNPV*4221A**	0.97	0.97	355AAV060080
CNPV*4821A**	0.98	0.98	355AAV060080
CSPH*4812A**	0.97	0.97	355AAV060080
CSPH*6012A**	0.98	0.96	355AAV060080
CAP**4821A**	0.98	0.94	355AAV060100
CNPH*4821A**	0.98	0.96	355AAV060100
CNPH*6024A**	1.00	0.98	355AAV060100
CAP**4824A**	0.98	0.96	355AAV060120
CAP**6024A**	1.00	0.96	355AAV060120
CNPV*4824A**	0.99	0.97	355AAV060120
CNPV*6024A**	1.00	0.98	355AAV060120

See notes on pg. 21

123A

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtuht†		Total System KW**	Capacity MBtuht†		Total System KW**	Capacity MBtuht†		Total System KW**	Capacity MBtuht†		Total System KW**	Capacity MBtuht†		Total System KW**	Capacity MBtuht†		Total System KW**
Total	Sens ‡	Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡				
123ANA060–A Outdoor Section With CAP**6024A** Indoor Section																			
1750	72	67.65	35.66	4.15	64.56	34.48	4.58	61.30	33.25	5.06	57.89	31.98	5.58	54.20	30.63	6.15	50.10	29.15	6.77
	67	62.07	43.94	4.10	59.24	42.75	4.53	56.25	41.50	5.01	53.12	40.22	5.54	49.74	38.85	6.11	46.03	37.38	6.74
	62	57.01	52.17	4.06	54.45	50.95	4.49	51.79	49.66	4.97	49.04	48.27	5.50	46.34	46.34	6.08	43.50	43.50	6.72
	57	55.50	55.50	4.04	53.42	53.42	4.48	51.22	51.22	4.96	48.89	48.89	5.50	46.35	46.35	6.08	43.51	43.51	6.72
2000	72	68.69	37.30	4.26	65.46	36.09	4.69	62.07	34.85	5.16	58.54	33.56	5.69	54.71	32.19	6.26	50.48	30.69	6.87
	67	63.07	46.60	4.21	60.11	45.38	4.64	57.00	44.12	5.11	53.75	42.82	5.64	50.27	41.45	6.21	46.44	39.94	6.84
	62	58.17	55.80	4.16	55.57	54.47	4.59	52.95	52.95	5.07	50.49	50.49	5.61	47.78	47.78	6.19	44.74	44.74	6.82
	57	57.57	57.57	4.16	55.35	55.35	4.59	52.99	52.99	5.07	50.50	50.50	5.61	47.78	47.78	6.19	44.74	44.74	6.82
2250	72	69.44	38.83	4.36	66.10	37.62	4.79	62.61	36.36	5.27	58.97	35.06	5.79	55.04	33.67	6.36	50.70	32.16	6.97
	67	63.79	49.12	4.31	60.73	47.89	4.74	57.53	46.62	5.21	54.20	45.31	5.74	50.63	43.90	6.31	46.72	42.34	6.93
	62	59.18	59.18	4.27	56.90	56.90	4.70	54.41	54.41	5.18	51.77	51.77	5.72	48.91	48.91	6.30	45.70	45.70	6.93
	57	59.25	59.25	4.27	56.90	56.90	4.70	54.42	54.42	5.18	51.78	51.78	5.72	48.91	48.91	6.30	45.70	45.70	6.93

Multipliers for Determining the Performance With Other Indoor Sections

Cooling Indoor Model	Capacity	Power	Furnace Model
*CAP**6024A**	1.00	1.00	
CAP**6021A**	0.98	0.98	
CNPH*6024A**	0.97	0.97	
CNPV*6024A**	0.99	0.99	
CSPH*6012A**	0.98	0.98	
FE4ANB006	0.99	0.97	
FV4BNB006	0.99	0.97	
FX4CN(B,F)060	1.01	1.01	
FY4ANB060	0.98	0.98	

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**6021A**	0.97	0.97	315(A,J)AV060110
CSPH*6012A**	0.97	0.97	315(A,J)AV060110
CAP**6024A**	0.98	0.98	315(A,J)AV066135
CNPH*6024A**	0.97	0.96	315(A,J)AV066135
CNPV*6024A**	0.97	0.97	315(A,J)AV066135
CSPH*6012A**	0.97	0.95	315(A,J)AV066135
CAP**6024A**	0.98	0.97	315(A,J)AV066155
CNPH*6024A**	0.98	0.97	315(A,J)AV066155
CNPV*6024A**	0.98	0.97	315(A,J)AV066155
CSPH*6012A**	0.97	0.95	315(A,J)AV066155

NOTE: When the required data fall between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

* Detailed cooling capacities are based on indoor and outdoor unit at the same elevation per ARI standard 210/240–94. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

** Total system kW is total of indoor and outdoor unit kilowatts.

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80°F (27°C) entering air at the indoor coil. For sensible capacities at other than 80°F (27°C), deduct 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80°F (27°C), or add 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air per degree above 80°F (27°C).

When the required data fall between the published data, interpolation may be performed.

123A

GUIDE SPECIFICATIONS

GENERAL

System Description

Outdoor-mounted, air-cooled, split-system air conditioner unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

- Unit will be rated in accordance with the latest edition of ARI Standard 210.
- Unit will be certified for capacity and efficiency, and listed in the latest ARI directory.
- Unit construction will comply with latest edition of ANSI/ASHRAE and with NEC.
- Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have c-UL approval.
- Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.
- Air-cooled condenser coils will be leak tested and pressure tested.
- Unit constructed in ISO9001 approved facility.

Delivery, Storage, and Handling

- Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

Warranty (for inclusion by specifying engineer)

- U.S. and Canada only.

PRODUCTS

Equipment

- Factory assembled, single piece, air-cooled air conditioner unit. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge Puron® (R-410A), and special features required prior to field start-up.

Unit Cabinet

- Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

Fans

- Condenser fan will be direct-drive propeller type, discharging air upward.

AIR-COOLED, SPLIT-SYSTEM AIR CONDITIONER

123A

1-1/2 TO 5 NOMINAL TONS

- Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated bearings. Shafts will be corrosion resistant.
- Fan blades will be statically and dynamically balanced.
- Condenser fan openings will be equipped with PVC-coated steel wire safety guards.

Compressor

- Compressor will be hermetically sealed.
- Compressor will be mounted on rubber vibration isolators.
- Compressor will be covered with a sound absorbing blanket.

Condenser Coil

- Condenser coil will be air cooled.
- Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

Refrigeration Components

- Refrigeration circuit components will include liquid-line shutoff valve with sweat connections, vapor-line shutoff valve with sweat connections, system charge of Puron® (R-410A) refrigerant, and compressor oil.
- Unit will be equipped with high-pressure switch, low pressure switch and filter drier for Puron refrigerant.

Operating Characteristics

- The capacity of the unit will meet or exceed _____ Btuh at a suction temperature of _____ °F. The power consumption at full load will not exceed _____ kW.
- Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of _____ Btuh or greater at conditions of _____ CFM entering air temperature at the evaporator at _____ °F wet bulb and _____ °F dry bulb, and air entering the unit at _____ °F.
- The system will have a SEER of _____ Btuh/watt or greater at DOE conditions.

Electrical Requirements

- Nominal unit electrical characteristics will be _____ v, single phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.
- Nominal unit electrical characteristics will be _____ v, three phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.
- Unit electrical power will be single point connection.
- Control circuit will be 24v.

Special Features

- Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.